



-----POWER ENTRY OPTIONS-----


DISCONNECT SWITCH

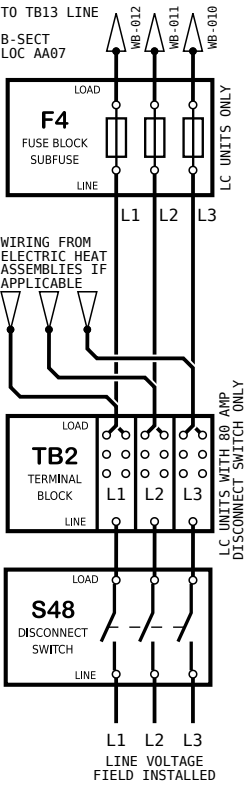

TERMINAL BLOCK

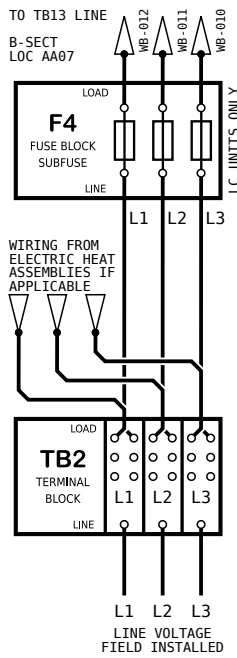


CIRCUIT BREAKER

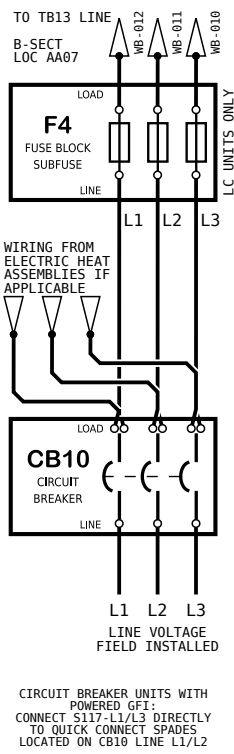

POWERED GFI OPTION - 120V FIELD PROVIDED POWER SUPPLY IS REQUIRED WHEN T29 TRANSFORMER IS NOT PROVIDED.

← DENOTES OPTIONAL COMPONENTS AND WIRING

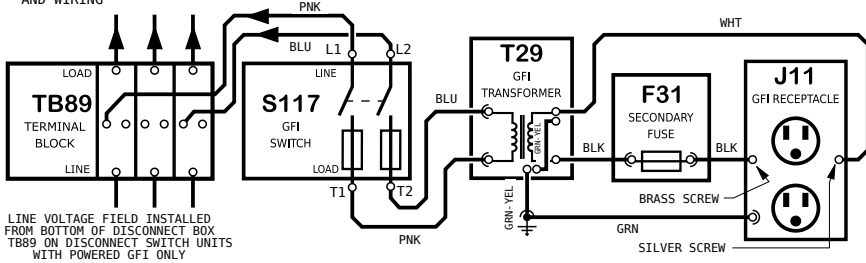


Model: LCT, LGT, LHT, LDT Series RTU
Power Entry Options 078 - 150
Voltage: All Voltages
Supersedes: XXXXXX-XX Form No: **538231-01** Rev: 1



Rev 1

538231-01



REV	EC NO.	DATE	BY	APVD	REVISION NOTE
---	CN-010219	07-25-2022	MCF	RXJ	ORIGINATED AT PD&R CARROLLTON, TX.
001	CN-010219K	09-26-2022	RXJ	MCF	ADDED 078 TO DRAWING TITLE.