






**PIPING**

**NOTE - See Refrigerant Pipe Selection Tables in VPC Outdoor Unit Installation Manual to Size Pipes**

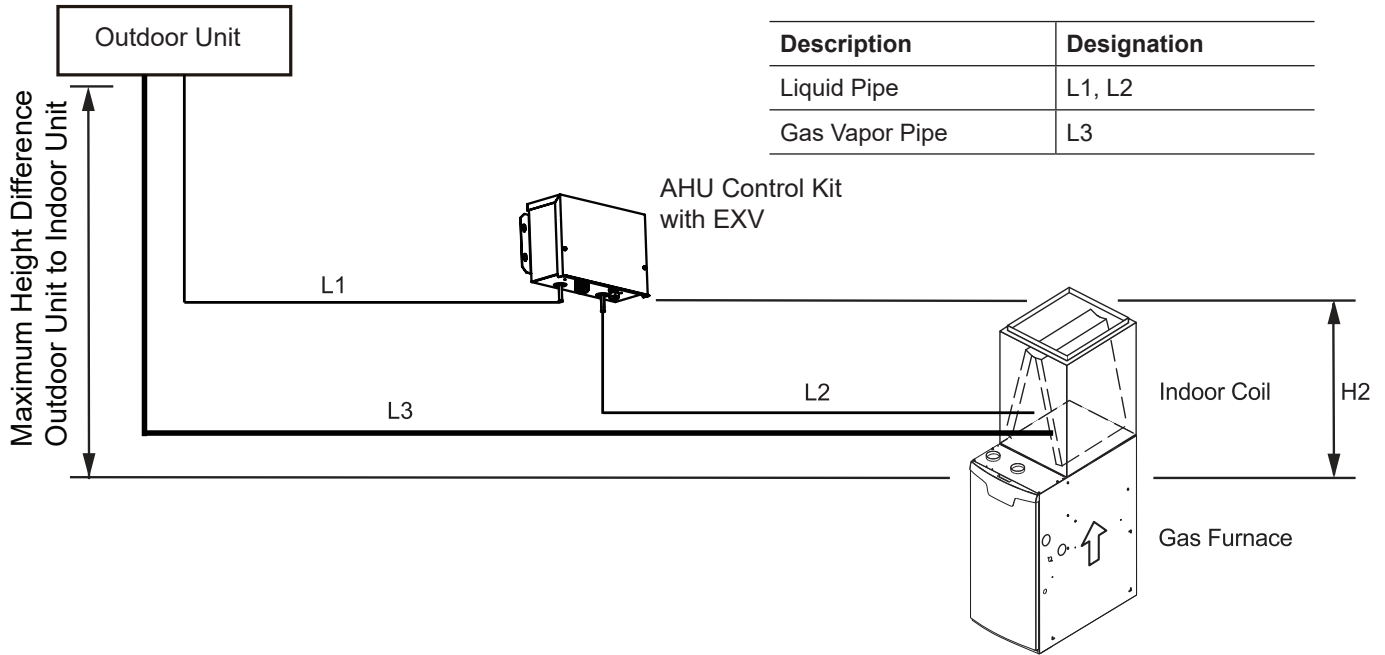

Description	Designation
Liquid Pipe	L1, L2
Gas Vapor Pipe	L3

Piping Length			Permitted value	Piping
Piping Length	Maximum piping length	AHU Control Kit to air handler/furnace coil	16 ft. (5 m)	L2
Level Difference	Maximum level difference	AHU Control Kit to air handler/furnace coil	+/- 16 ft. (5 m)	H2
Maximum Height Difference	Indoor Unit to Outdoor Unit Maximum Height Difference	Outdoor Unit Up	≤164 ft. (50 m)	--
		Outdoor Unit Down	≤131 ft. (40 m)	--
	Indoor Unit to Indoor Unit Maximum Height Difference		≤49 ft. (15 m)	--

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

Installation and service must be performed by a qualified installer and servicing agency.