

SUBMITTAL DATA - OUTDOOR UNIT **VRB240L4M-3Y**

VRB120L4M-3Y + VRB120L4M-3Y

VRF Heat Recovery

Construction

Job:	
Location:	
Schedule No.:	

System Designation:

Heat Recovery Outdoor Unit

	FE,	AT	UR	ES	
--	-----	----	----	----	--

- Split coil heat exchanger
- · Dual hinged electrical boxes for ease of maintenance
- · High-efficiency vapor injection inverter compressor
- Intelligent Duty Cycle operation

Engineer: Architect: Location:

Date:

For:

Reference

- · Night Silent operation
- · Hinged service doors
- · Built-in service console
- Built-in base pan heater

Approval

- · Heating Operation down to -22F
- · Low Ambient Cooling down to -10F w/ kit

Review

WARRANTY

· Compressor - 10-year limited warranty

· All other components - 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	240,000
	Rated ²	230,000
EER	Ducted	11.4
	Non-Ducted	11.4
IEER	Ducted	22.3
	Non-Ducted	23.3
SCHE	Ducted	28.6
	Non-Ducted	31.4
Heating Capacity ¹ (Btu/h)	Nominal	270,000
	Rated ²	258,000
COP47	Ducted	3.63
	Non-Ducted	3.74
COP17	Ducted	2.46
	Non-Ducted	2.40

ELECTRICAL DATA

Power Supply (Volts/Phase/Hertz)	208-230/3/60
Minimum Circuit Ampacity (A)	82.6+82.6
Maximum Overcurrent Protection (A)	90+90
Compressor RLA (A)	(2) 33+33
Number of Compressors	(2) 2
Outdoor Fan Power Input (W)	(2) 1200/1200
Outdoor Fan FLA (A)	(2) 4.0/4.3

GENERAL DATA Connection Ratio 50% to 130% Maximum Number of Indoor Units 44 R-410A Refrigerant Type Factory Refrigerant Charge (each unit) 23.8 lbs.

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor.
- 2. Complies with AHRI 1230-2014 testing standards
- Operating Voltage Range 175V to 263V 3.
- 4. To achieve cooling lower than 5°F a Low ambient hood must be installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.



DIMENSIONS	(E	ach Module)
Unit	Height	72
Dimensions (in)	Width	68-1/2
	Depth	32-5/8
Main System Piping (i	in)	
Liquid Pipe Connection		3/4
Gas Pipe Connection		1-1/4
Balancing Pipework b	etween	Modules (in)
L.P. Gas Balance Pipe Connection		1-1/4
H.P. Gas Balance Pipe Connection		3/4
Oil Balance Pipe Conne	ection	5/16
Unit Net Weight (lb)		1093




NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495885 (202010)



DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

Model No.	AA		BB		CC		DD	
	Ibs.	kg	Ibs.	kg	Ibs.	kg	Ibs.	kg
096, 120L4M-3Y	171	78	262	119	327	148	318	144
096, 120L4M-3G	173	78	266	121	332	151	323	147

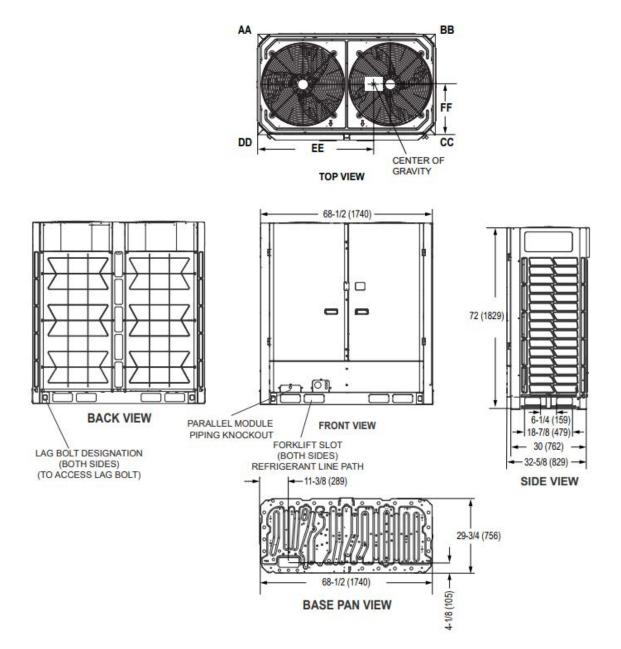

 NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensional objects and Dimensional adjustment, alteration, service or maintenance can cause property damage or personal injury.

 Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.


 495885 (202010)
NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

©2020 Lennox Industries Inc.




MULTI-MODULE INFORMATION

Multi-Module Dimensions

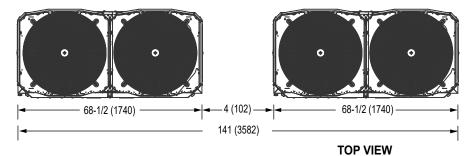

NOTE - All the outdoor units manifolded together should be installed at the same elevation.

Multi-Module Power

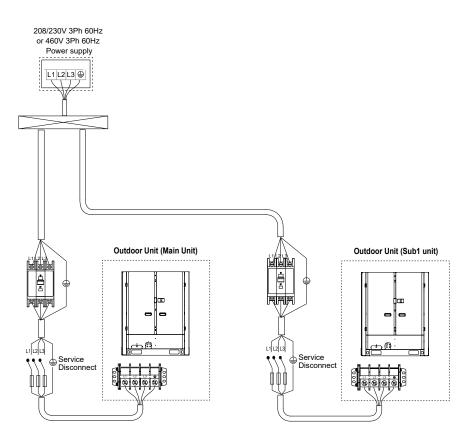

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

Installation and service must be performed by a qualified installer and servicing agency.