

Job:	
Location:	
Schedule No.:	
System Designation:	

FEATURES

Outdoor Unit: MPB009S4S-1P

SUBMITTAL DATA – **DUCTED** MPB009S4S-1P – MMDB009S4-2P

SINGLE ZONE MINI-SPLIT HEAT PUMP

Engineer:

Architect:

Date:

For:
Reference
Approval
Review
Construction

Indoor Unit: MMDB009S4-2P



- DC =nverter 7 ontrol
- Compressor Overcurrent Protection
- Base Dan < eater
- Defrost 7 ontrol



- Auxiliary Heat Function
- Auto Restart
- Built-In Condensate Pump
- Three Selectable Fan Speeds
- Flare Connections
- LED Readout Panel
- Wired Remote Controller Included

PIPING

Line Set and Elevation Guidelines	
Maximum Line Set Length ft. (m)	82 (25)
Maximum Elevation - Outdoor Unit Below/Above Indoor Unit ft. (m)	33 (10)
Liquid Line Set Diameter (in.)	1/4
Gas Line Set Diameter (in.)	3/8
Pre-Charged (ft.)	25
Additional Charge of Refrigerant (oz/ft.)	0.16

PRODUCT WARRANTY

Compressor – Twelve year limited warranty* All other covered components - Twelve year limited warranty* *Product registration required





OPTIONAL ACCESSORIES

Hail Guards (M9GARD19Q-1) Programmable Controller (M0STAT64Q-1)



NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings, and Dimensions are subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.



SUBMITTAL DATA – **DUCTED** M**PB**009S4S-1P – M**MDB**009S4-**2**P

SINGLE ZONE MINI-SPLIT HEAT PUMP

OUTDOOR SPECIFICATIONS	
PERFORMANCE	
Cooling Capacity (Btu/h) ¹	9,000
EER	13.5
SEER	20.5
Heating Capacity (Btu/h) ¹	10,000
HSPF	11.5
Outdoor Fan Total Air Volume (CFM)	1,200
Ambient Temperature Operating Range	
Cooling	-13°F - 122°F
Heating	-13°F - 86°F
ELECTRICAL DATA	
Power Supply (V/Hz/Φ)	208-230/60/1
Minimum Circuit Ampacity (A)	10
Maximum Overcurrent Protection (A)	15
Outdoor Fan Motor RLA (A)	0.4
Compressor RLA (A)	5.5
No. of Compressors	1


GENERAL DATA		
Connection Ratio (%)		100%
Max. # of Indoor Units		1 unit
Sound Data (dBA) - Cooling/Heating		55/55
Refrigerant type		R-410A
Factory refrigerant charge		2 lbs. 7 oz.
DIMENSIONS		
Unit Dimensions (in)	Height	21-7/8
	Width	30-3/8
	Depth	11-3/4
Shipping Weight (lb)		67
Net Weight (lb)		62
NOTES		

1. Cooling and Heating Capacity data is rated at the following conditions:

Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor

Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor

OUTDOOR DIMENSIONAL DRAWINGS - INCHES (MM)

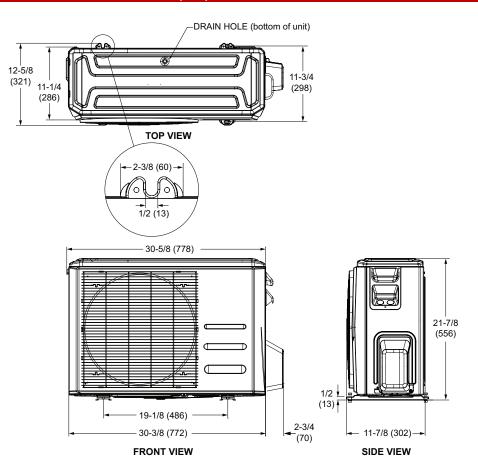

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings, and Dimensions are subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.



SUBMITTAL DATA – DUCTED MPB009S4S-1P – MMDB009S4-2P SINGLE ZONE MINI-SPLIT HEAT PUMP

INDOOR SPECIFICATIONS


PERFORMANCE		
Airflow (CFM)	High	340
	Medium	270
	Low	165
External Static Pressure (in.	w.g.)	0 - 0.16
Sound Pressure (dBA)	High	38
	Medium	32
	Low	25

WIRED REMOTE CONTROLLER SPECIFICATIONS

M0STAT61Q-1	
Input Voltage (V)	5Vdc
Communication Cabling	Factory 4-wire harness
Operating Temperature Range	23°F to 110°F
Operating Humidity Range (RH)	40% ~ 90%
Setpoint Range	62°F ~ 86°F

ELECTRICAL DATA		
Power Supply (V/Hz/Φ)		Supplied by ODU
Rated load amps (RLA)		.9
Power Output (W)		55
DIMENSIONS		
Unit Dimensions (in)	Height	7-7/8
	Width	30-3/4
	Depth	19-7/8
Unit Net/Shipping Weight (lb)		38/49
PIPING		
Liquid/Gas O.D. Flare (in.)		1/4,3/8
Drain Connection O.D. (in.)		1

DISPLAY

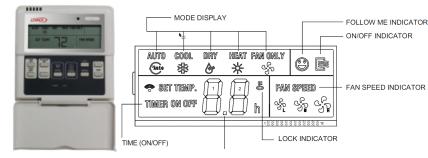

INDOOR DIMENSIONAL DRAWINGS - INCHES (MM)


Please See Page I

SUBMITTAL DATA - DUCTED





SINGLE ZONE MINI-SPLIT HEAT PUMP

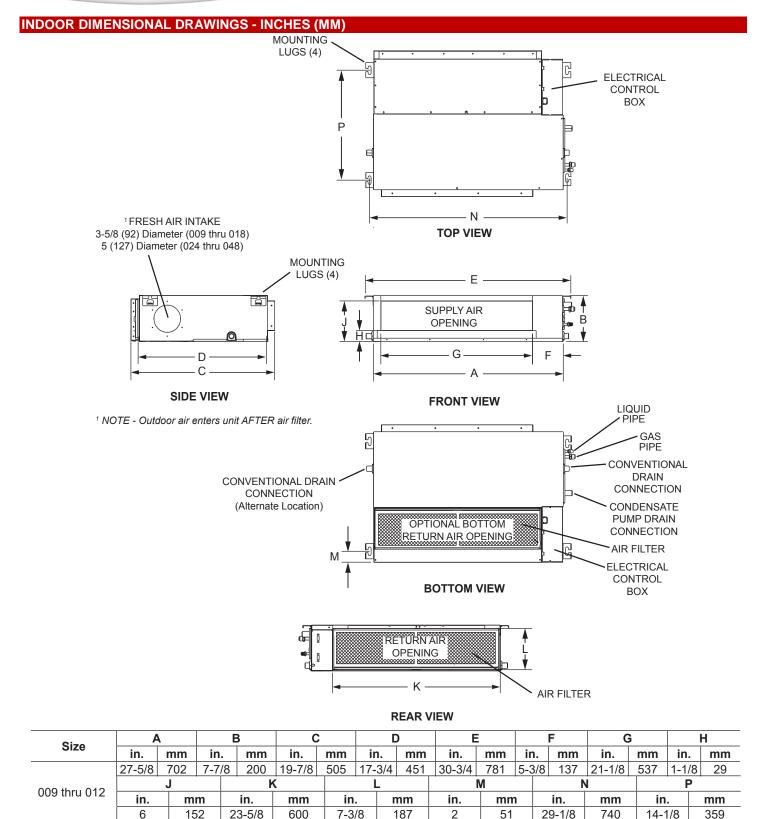

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings, and Dimensions are subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.