

SUBMITTAL DATA - OUTDOOR UNIT VRB456H4M-3Y

VRB168H4M-3Y + VRB144H4M-3Y+ VRB144H4M-3Y VRF Heat Recovery

Job:	Engineer:	
Location:	Architect:	
Schedule No.:	Location:	
System Designation:	Date:	

For:

DIMENSIONS

Reference

Heat Recovery Outdoor Unit

F	EATURES	
•	Split coil heat exchanger	

- · High-efficiency vapor injection inverter compressors
- · Hinged service doors

Approval

· Built-in service console

Review

Construction

- · Built-in base pan heater
- · Low Ambient Cooling

- · Dual hinged electrical boxes for ease of maintenance
- · Intelligent Duty Cycle operation
- · Night Silent operation

- WARRANTY
- Compressor 10-year limited warranty
- All other components 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE			
Cooling Capacity ¹ (Btu/h)	Nominal	456,000	
()	Rated ²	436000	
EER	Ducted	9.5	
	Non-Ducted	9.5	
IEER	Ducted	17.3	
	Non-Ducted	17.3	
Simultaneous Heating and	Ducted	21.5	
Cooling Efficiency (SCHE)	Non-Ducted	21.9	
Heating Capacity ¹ (Btu/h)		490,000	
COP47	Ducted	3.2	
	Non-Ducted	3.2	
COP17	Ducted	2.3	
	Non-Ducted	23	



ELECTRICAL DATA				
Power Supply (Volts/Phase/Hertz)	208-230/3/60			
Minimum Circuit Ampacity (A)	(3) 69.5			
Maximum Overcurrent Protection (A)	(3) 80			
Compressor RLA (A)	(3) 27.2/27.2			
Number of Compressors	(3) 2			
Outdoor Fan Power Input (W)	(3) 1200/1200			
Outdoor Fan FLA (A)	(3) 4.0/4.3			
GENERAL DATA				
Connection Ratio	50% to 130%			
Maximum Number of Indoor Units	64			
Refrigerant Type	R-410A			
Factory Refrigerant Charge (each unit)	23.8 lbs.			

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor
- 2. Complies with AHRI 1230-2014 testing standards
- Operating Voltage Range 175V to 263V 3.
- To achieve cooling lower than 5°F a Low ambient hood must be 4 installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.

Height 72 72 72 Unit Width 68-1/2 68-1/2 68-1/2 Dimensions (in) Depth 32-5/8 32-5/8 32-5/8 Main System Piping (in) Liquid Pipe Connection 3/4 3/4 3/4 High Pressure Gas Pipe 1-3/8 1-3/8 1-3/8 Low Pressure Gas Pipe 1-3/8 1-3/8 1-3/8 Balancing Pipework between Modules (in) Gas Balance Pipe Connection 3/4 3/4 3/4 **Oil Balance Pipe Connection** 1/4 1/4 1/4 Unit Net Weight (lb) 1118 1118 1118

VRB168

VRB144

VRB144



NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2024 Lennox Industries Inc.




SUBMITTAL DATA - OUTDOOR UNIT VRB456H4M-3Y VRB168H4M-3Y + VRB144H4M-3Y+ VRB144H4M-3Y

VRF Heat Recovery

DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS								CENTER OF GRAVITY			
A	A	В	В	CC DD		D	EE		FF		
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
172	78	264	120	330	150	321	146	37-3/4	953	12	305

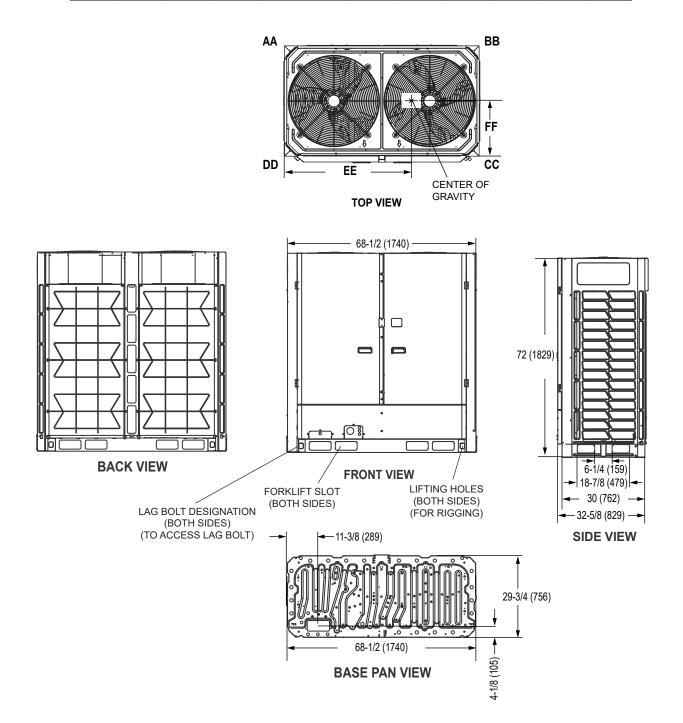

 NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

 Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

 Installation and service must be performed by a qualified installer and servicing agency.
 495780 (202402)
 ©2024 Lennox Incurrent





SUBMITTAL DATA - OUTDOOR UNIT VRB456H4M-3Y VRB168H4M-3Y + VRB144H4M-3Y+ VRB144H4M-3Y

VRF Heat Recovery

MULTI-MODULE INFORMATION



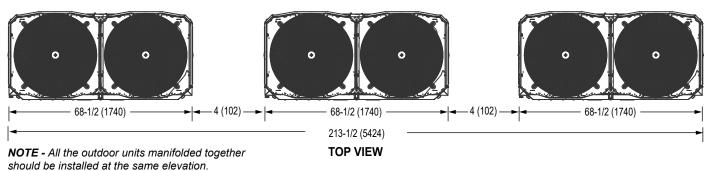

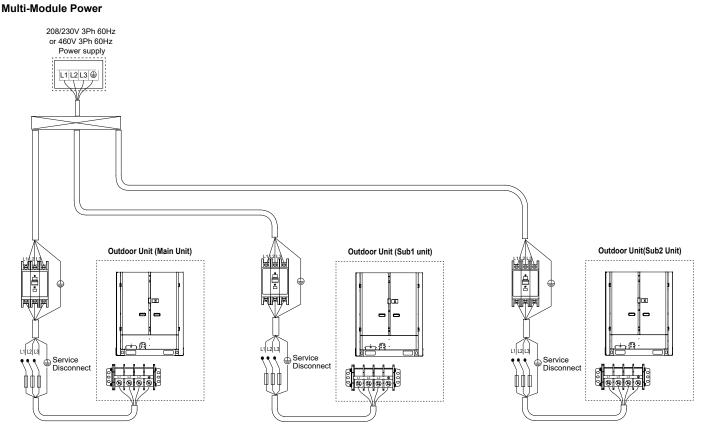

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.