

Job:

Location:

Schedule No.:

System Designation:

Medium Static Ducted Indoor Unit

FEATURES

- Pre Heat Function
- Auto Addressing
- Integral Condensate Pump
- Electronic Expansion Valve
- Auto Restart
- ECM Motor

SPECIFICATIONS		
PERFORMANCE		
Cooling Capacity ¹ (Btu/h)		8,500
Heating Capacity ¹ (Btu/h)		10,900
Airflow (CFM)	High	330
	Medium	260
	Low	220
External Static Pressure (in. WC)		0.32
Sound Pressure (dBA)	High	32.7
	Medium	32.4
	Low	31.8
ELECTRICAL DATA		
Power Supply (V/Hz/Φ)		208-230/60/1
Minimum circuit ampacity (MCA)		1.25
Max. Overcurrent Protection (MOCP)		15
Cooling Power Input ² (W)		35
Cooling Rated current (A)		0.5
Heating Power Input ² (W)		30
Heating Rated current (A)		0.5
Indoor Fan Motor Input (W)		47
DIMENSIONS		
Unit Dimensions (in)	Height	8-1/4
	Width	39-3/8
	Depth	17-3/4
Liquid Pipe Connection (in)		1/4
Gas Pipe Connection (in)		1/2
Condensate drain connection (in)		1
Unit Shipping Weight (Ib)		58
Unit Net Weight (Ib)		51

SUBMITTAL DATA - INDOOR UNIT VMDB009H4-2P

VRF HEAT PUMP & HEAT RECOVERY

Engineer:

Architect:

Date:

For:
Reference
Approval
Review
Construction

- Flare Connections
 - LED Display

• Foldable Return Air Filter

- Refrigerant R-410A
- Nine capacity sizes from 7,000 to 48,000 Btu/h



OPTIONAL ACCESSORIES

□Non-Programmable Controller	V0STAT54P
Programmable Controller	V0STAT51P
□Infrared Wireless Controller	V0STAT52P-1
□Infrared Sensor	V0SNSR78P-1
□Remote Sensor	V0SNSR00P-1
□HHE Relay Kit	V0CTRL92P-1
Hotel Keycard Interface	V0CTRL88P-1

NOTES

1. Cooling and Heating capacity data is rated at the following conditions:

Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor

2. Power Input values are rated at high fan speed.








SUBMITTAL DATA – INDOOR UNIT VMDB009H4-2P


VRF HEAT PUMP & HEAT RECOVERY

DIMENSIONAL DRAWINGS - INCHES (MM)

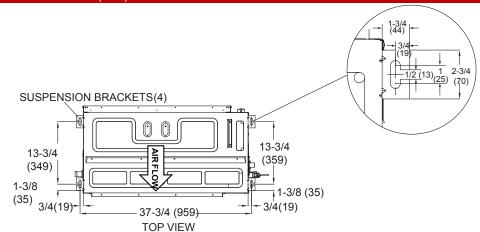

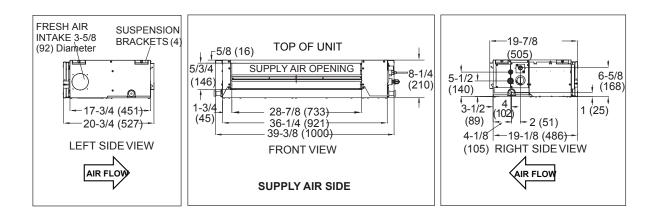

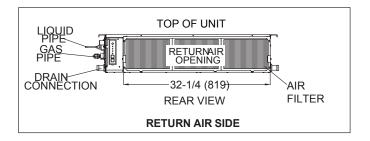

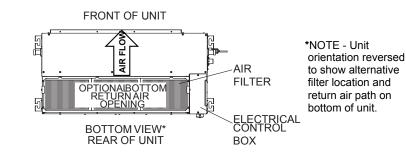

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495574 (201810) ©2018 Lennox Industries Inc.