

SUBMITTAL DATA - OUTDOOR UNIT **VRB480H4M-3Y**

VRB168H4M-3Y + VRB168H4M-3Y+ VRB144H4M-3Y

VRF Heat Recovery

Construction

Job:	Engineer:	
Location:	Architect:	
Schedule No.:	Location:	
System Designation:	Date:	

Heat Recovery Outdoor Unit

FEATURES

- · Split coil heat exchanger
- · Dual hinged electrical boxes for ease of maintenance
- · High-efficiency vapor injection inverter compressors

· Intelligent Duty Cycle operation

· Night Silent operation

For:

Reference

- · Hinged service doors
 - · Built-in service console

Approval

Review

- · Built-in base pan heater
- · Low Ambient Cooling

WARRANTY

- · Compressor 10-year limited warranty
- All other components 10-year limited warranty *See warranty for details

SPECIFICATIONS

PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	480,000
······································	Rated ²	456000
EER	Ducted	9.3
	Non-Ducted	9.3
IEER	Ducted	16.8
	Non-Ducted	16.8
Simultaneous Heating and	Ducted	21.1
Cooling Efficiency (SCHE)	Non-Ducted	21.3
Heating Capacity ¹ (Btu/h)		510,000
COP47	Ducted	3.2
	Non-Ducted	3.2
COP17	Ducted	2.25
	Non-Ducted	2.25

ELECTRICAL DATA

208-230/3/60		
(3) 69.5		
(3) 80		
(3) 27.2/27.2		
(3) 2		
(3) 1200/1200		
(3) 4.0/4.3		
50% to 130%		
64		
R-410A		
23.8 lbs.		

NOTES

- Cooling and Heating capacity data is rated at the following 1. conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor
- 2. Complies with AHRI 1230-2014 testing standards
- 3. Operating Voltage Range 175V to 263V
- To achieve cooling lower than 5°F a Low ambient hood must be 4. installed. This is purchased as an accessory.
- 5. A local 115V power outlet is available as an accessory to provide local power for maintenance.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

495782 (202402)

Intertek



DIMENSIONS		VRB168	VRB168	VRB144				
Unit	Height	72	72	72				
Dimensions (in)	Width	68-1/2	68-1/2	68-1/2				
	Depth	32-5/8	32-5/8	32-5/8				
Main System Piping (in)								
Liquid Pipe Connecti	3/4	3/4	3/4					
High Pressure Gas Pipe		1-3/8	1-3/8	1-3/8				
Low Pressure Gas Pipe		1-3/8	1-3/8	1-3/8				
Balancing Pipework between Modules (in)								
Gas Balance Pipe Co	onnection	3/4	3/4	3/4				
Oil Balance Pipe Cor	1/4	1/4	1/4					
Unit Net Weight (lb)		1118	1118	1118				






SUBMITTAL DATA - OUTDOOR UNIT VRB480H4M-3Y VRB168H4M-3Y + VRB168H4M-3Y+ VRB144H4M-3Y

VRF Heat Recovery

DIMENSIONAL DRAWINGS - INCHES (MM)

Each Module

CORNER WEIGHTS						CENTER OF GRAVITY					
AA		BB		CC DD		D	E	E	F	F	
lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
172	78	264	120	330	150	321	146	37-3/4	953	12	305

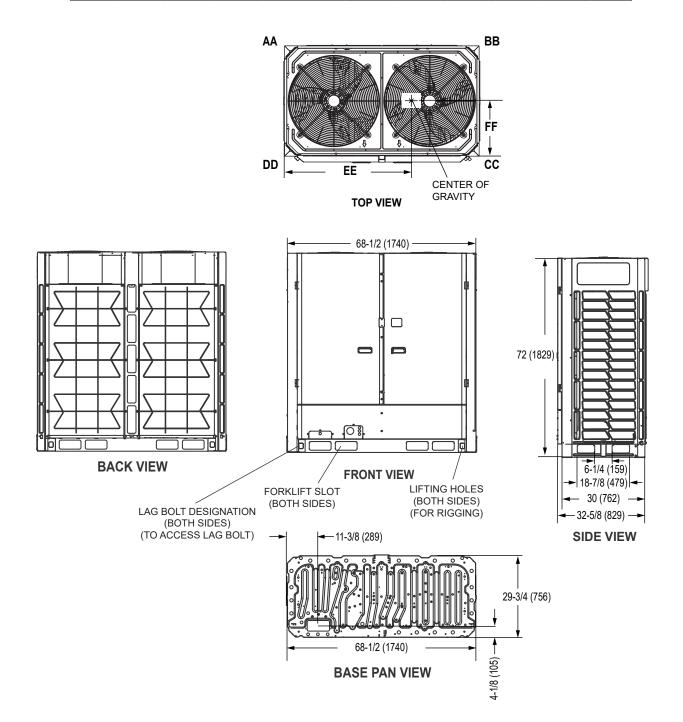

 NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

 Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.

 Installation and service must be performed by a qualified installer and servicing agency.
 495782 (202402)
 ©2024 Lennox Incurrent




SUBMITTAL DATA - OUTDOOR UNIT VRB480H4M-3Y VRB168H4M-3Y + VRB168H4M-3Y+ VRB144H4M-3Y

VRF Heat Recovery

MULTI-MODULE INFORMATION




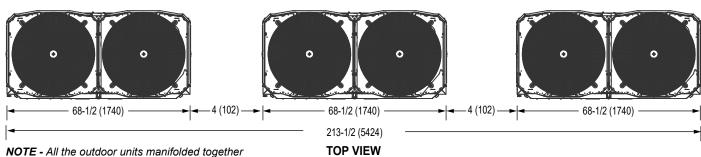

should be installed at the same elevation.

TOP VIEW

Multi-Module Power

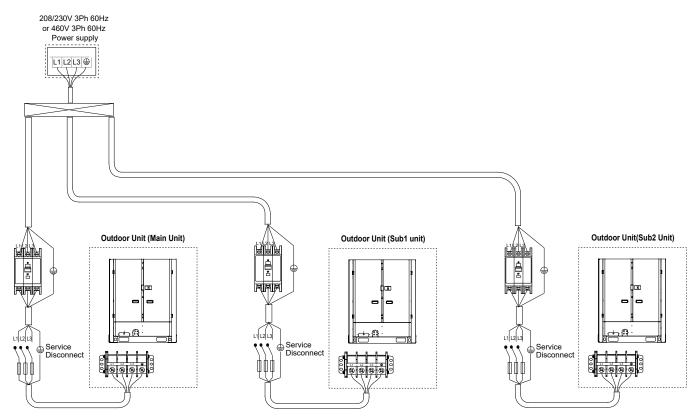

See page 1 for electrical data.

Total system MCA is calcuated by adding the MCA value of each module together to get the total system MCA.

Total system MOP is calcuated by adding the MOP value of each module together to get the total system MCA.

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.

Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.